

FIG.1A

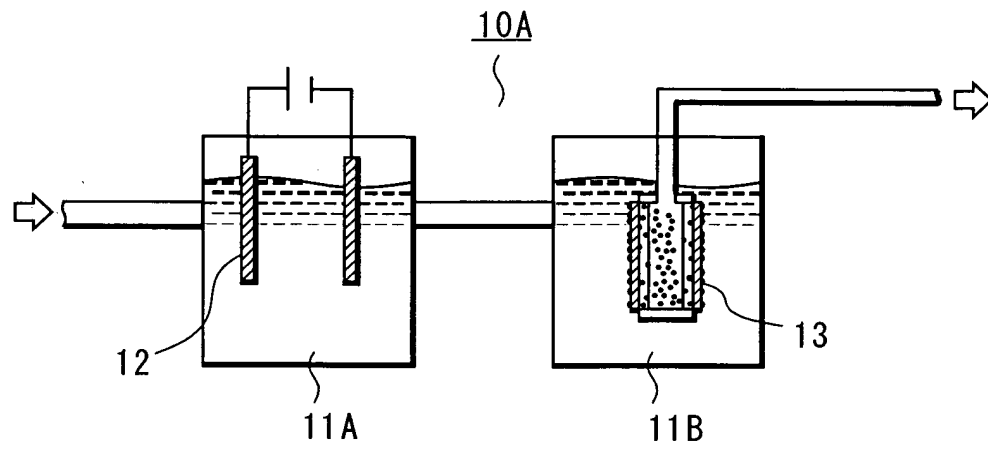


FIG.1B

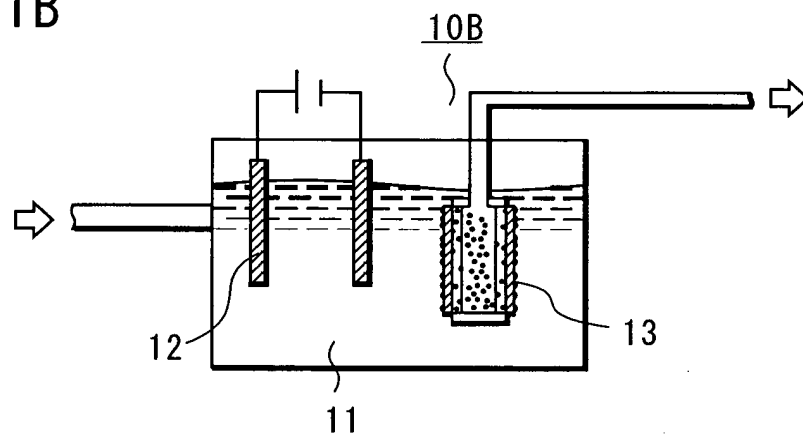


FIG.1C

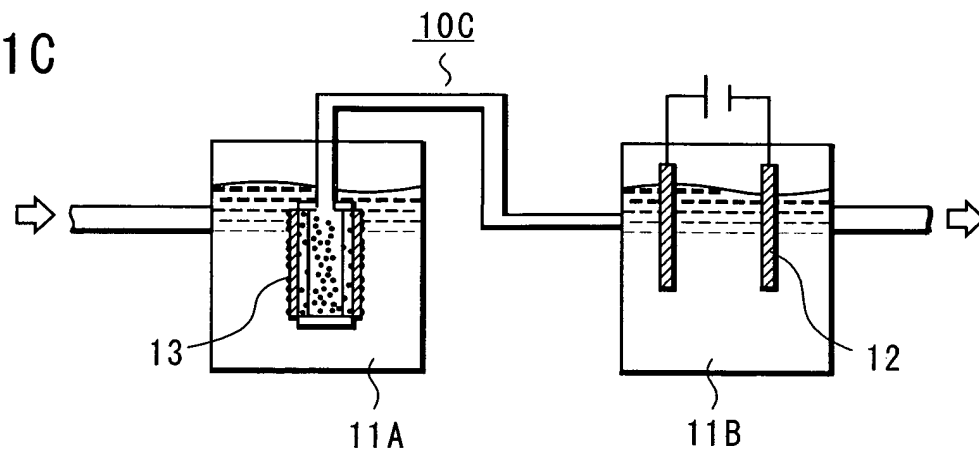


FIG.2

2/17

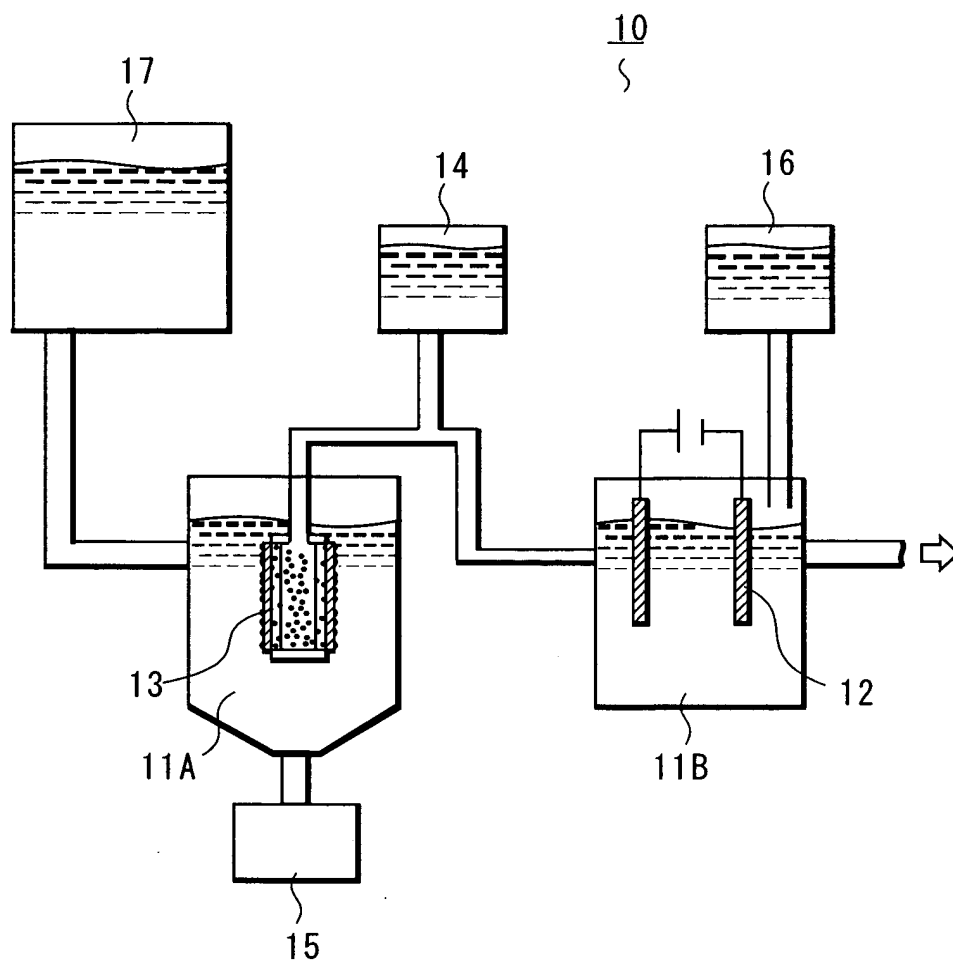


FIG.3

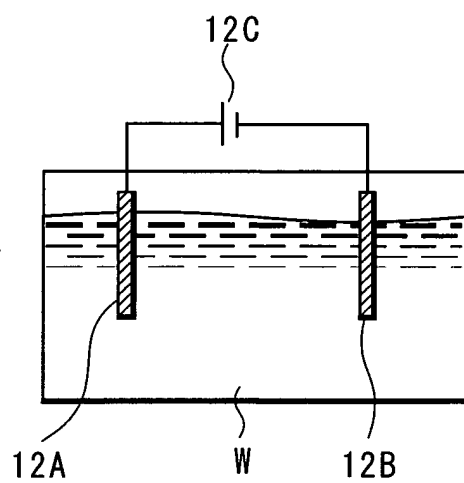


FIG. 4A

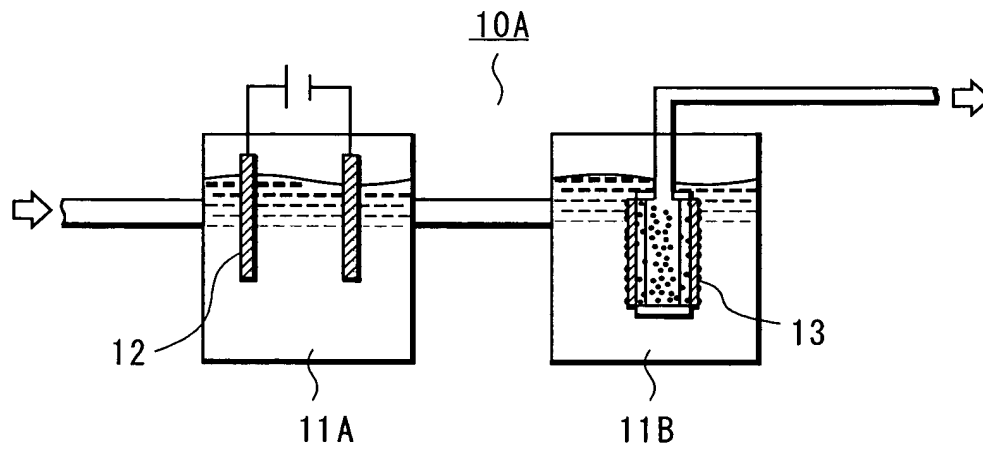


FIG. 4B

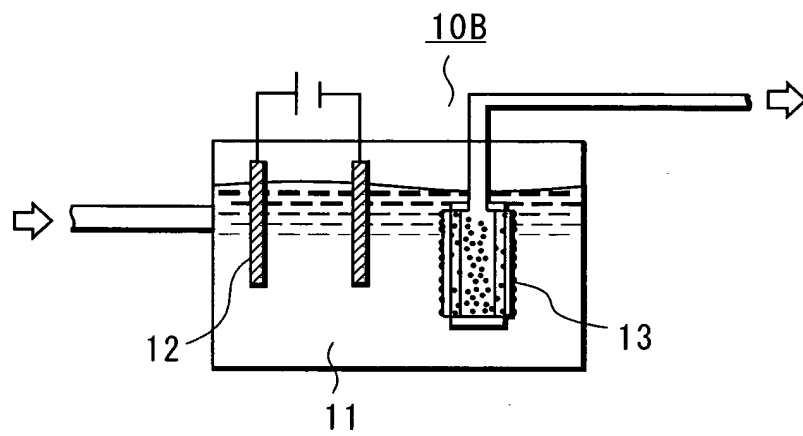


FIG. 5

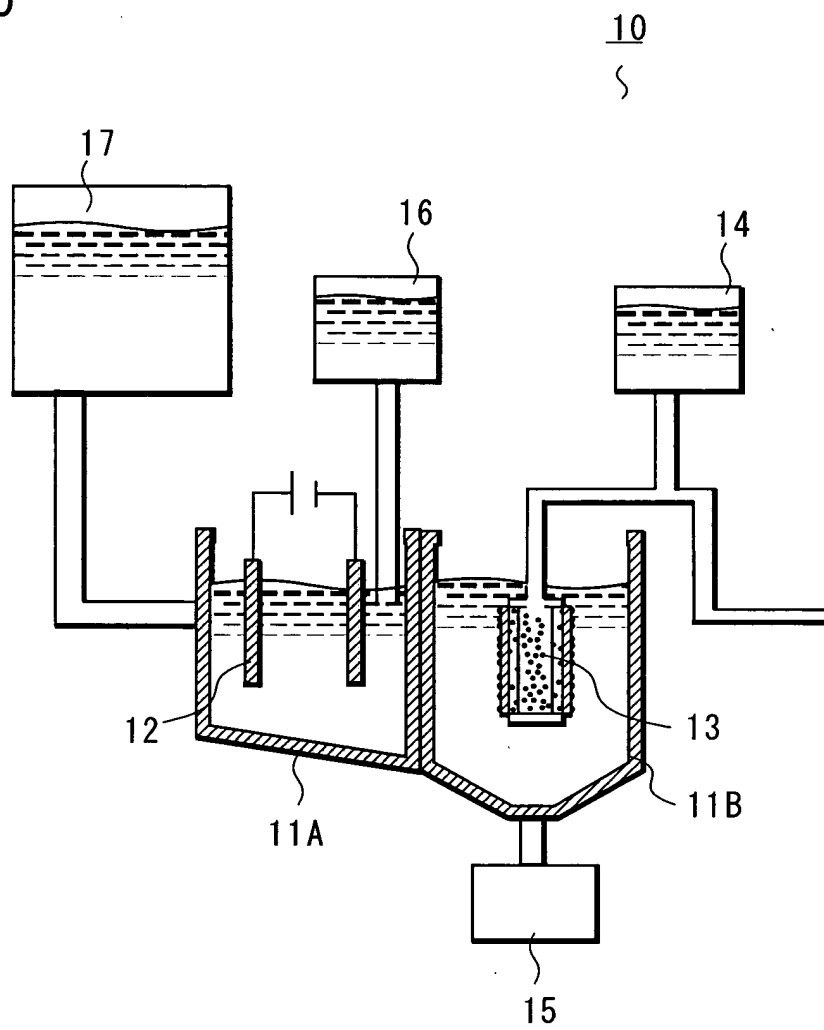


FIG. 6A

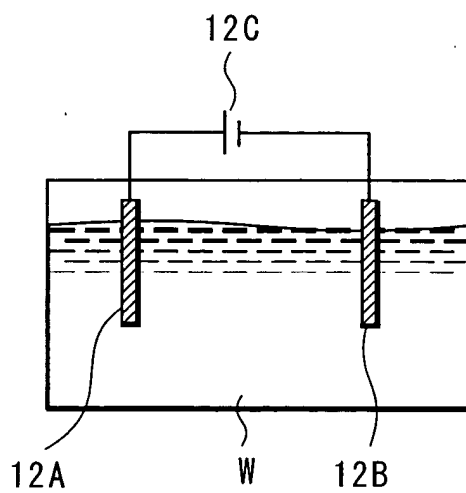


FIG. 6B

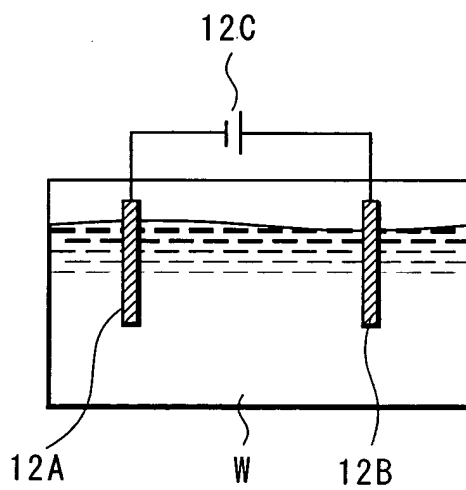


FIG. 7

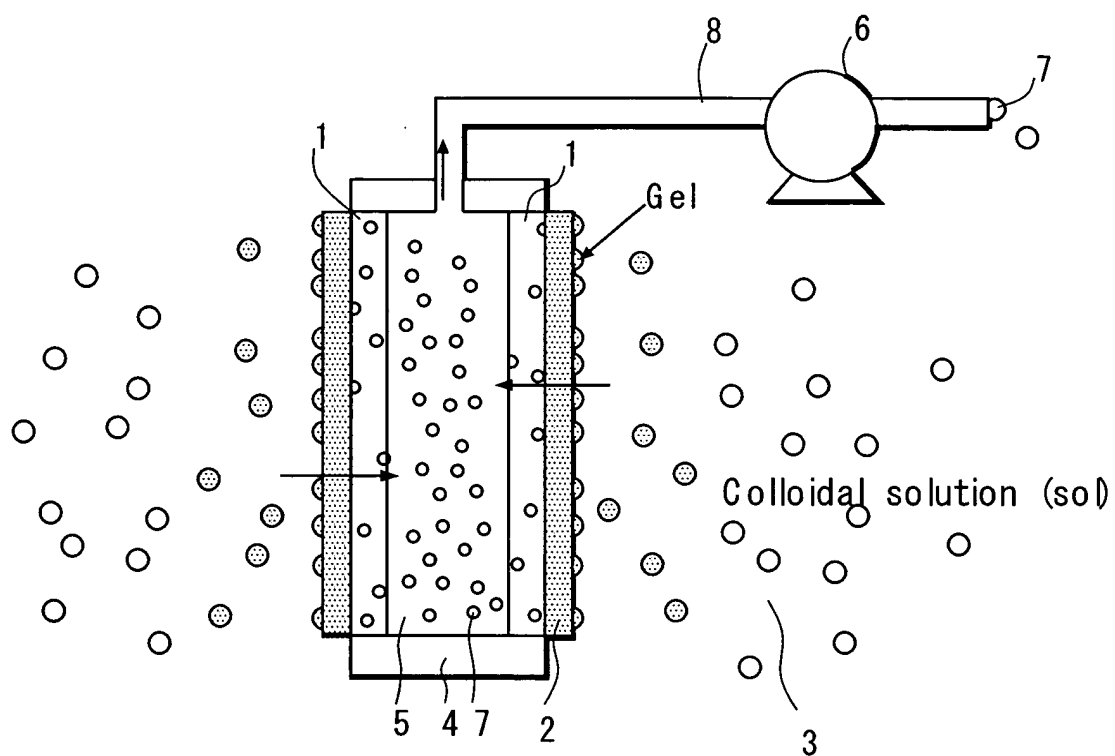


FIG. 8A

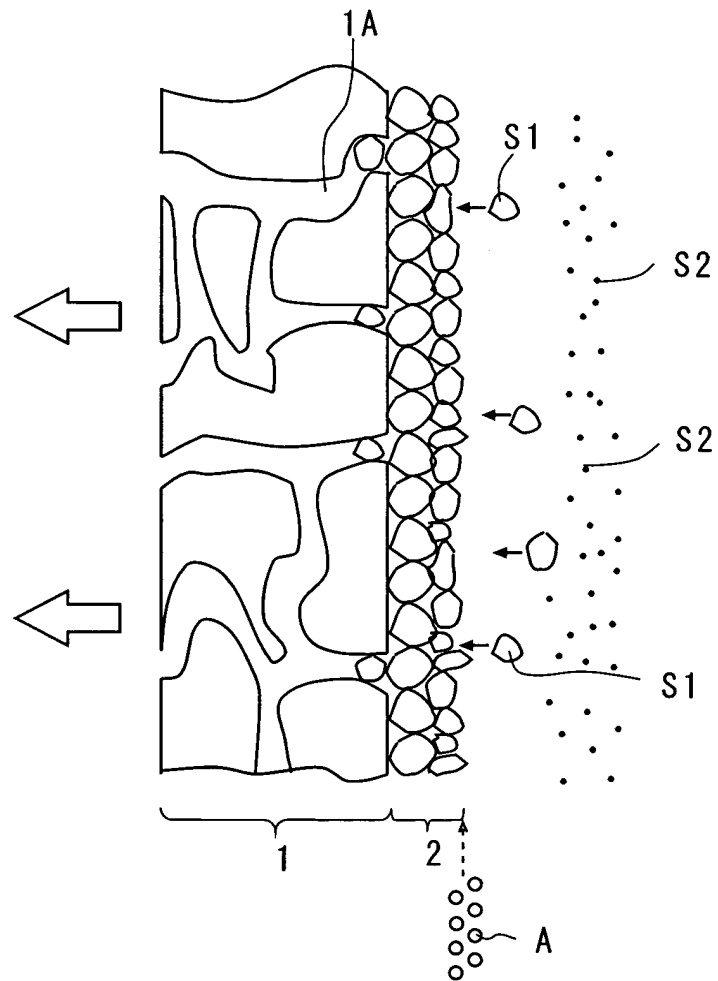


FIG. 8B

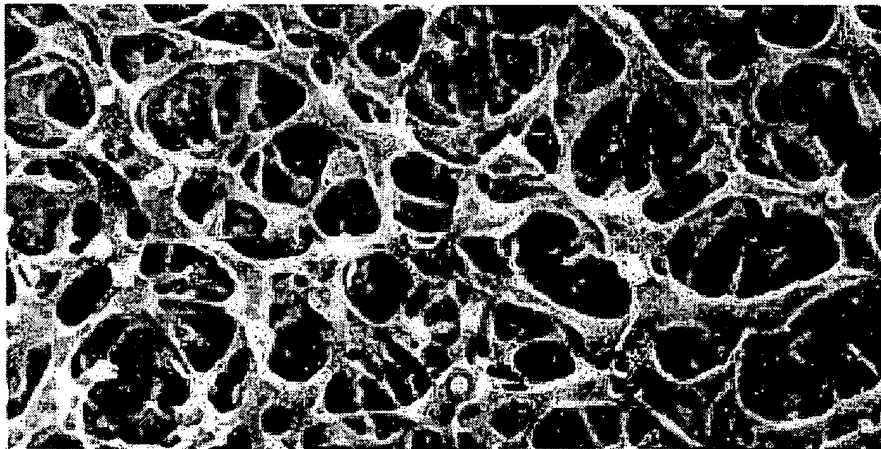


FIG.9A


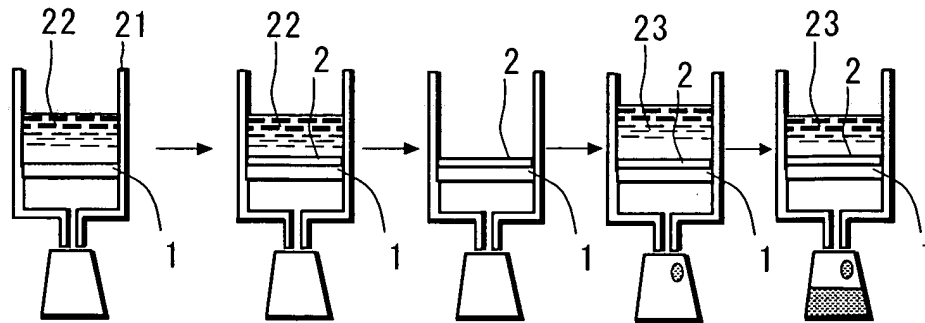


FIG.9B

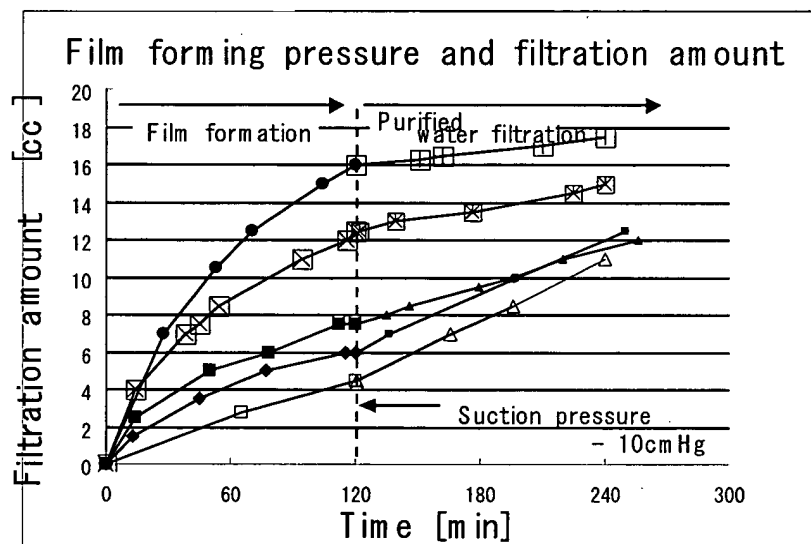

- -55cmHg
- + Purified water filtration amount
- ⊠ -30cmHg
- ⊞ Purified water filtration amount
- -10cmHg
- ▲ Purified water filtration amount
- ◆ -5cmHg
- Purified water filtration amount
- ⊡ -2cmHg
- △ Purified water filtration amount



FIG.10

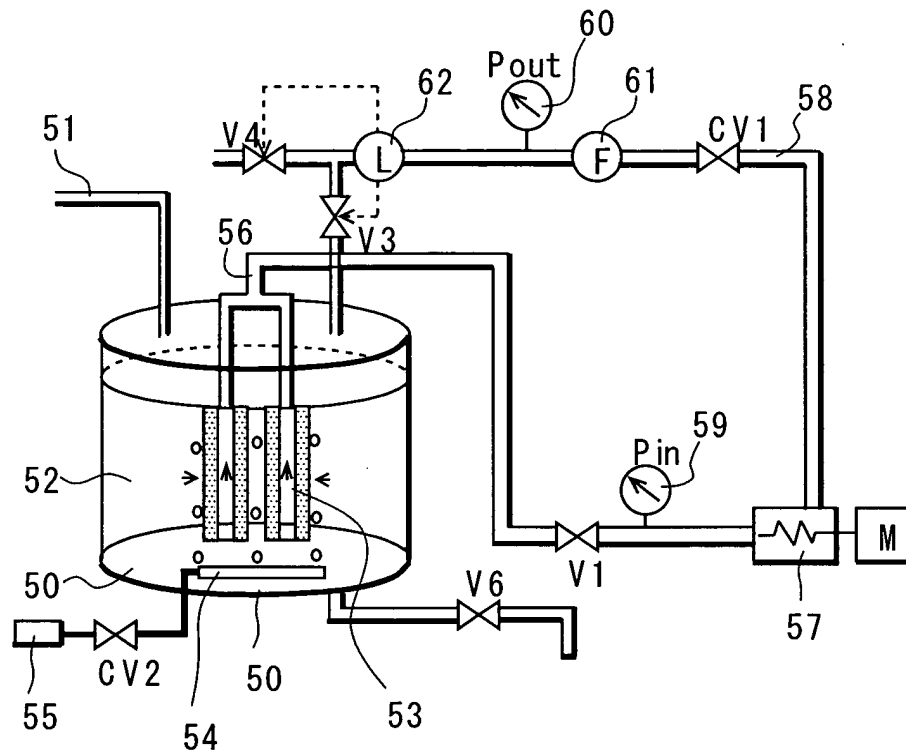


FIG. 11A

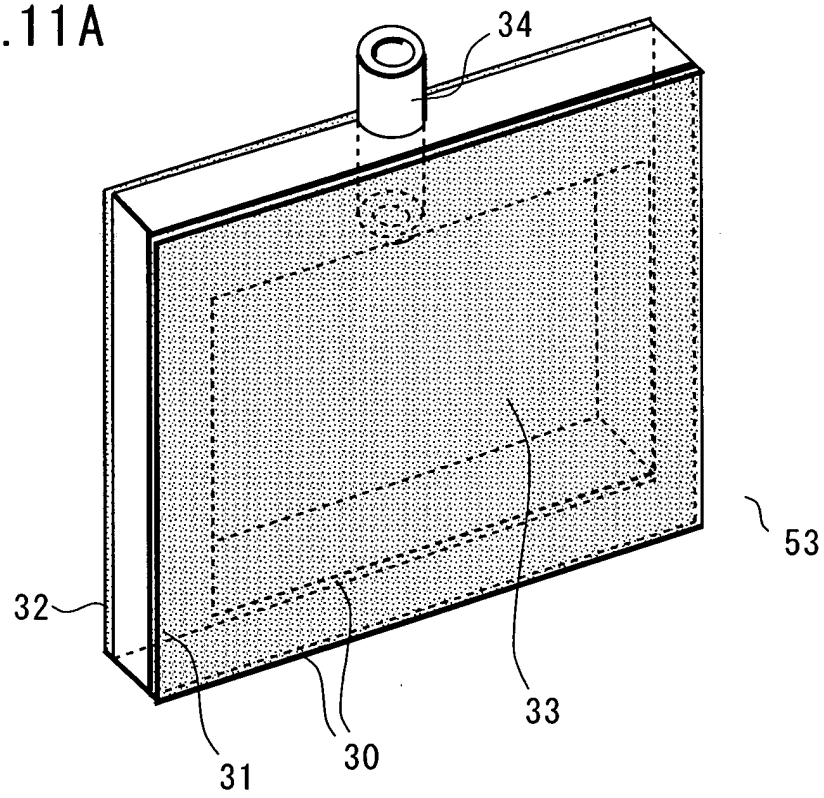


FIG. 11C

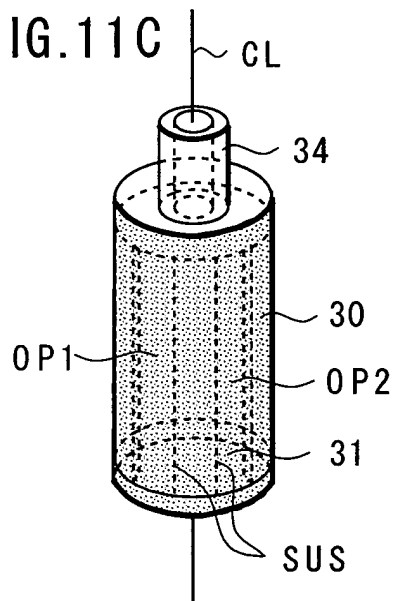


FIG. 11B

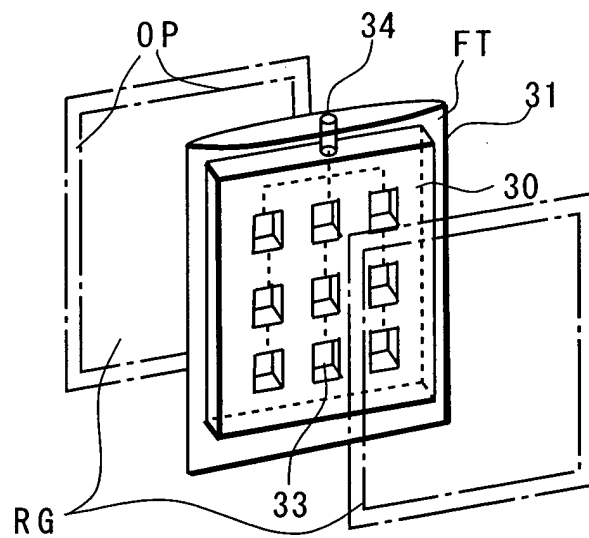


FIG.12A

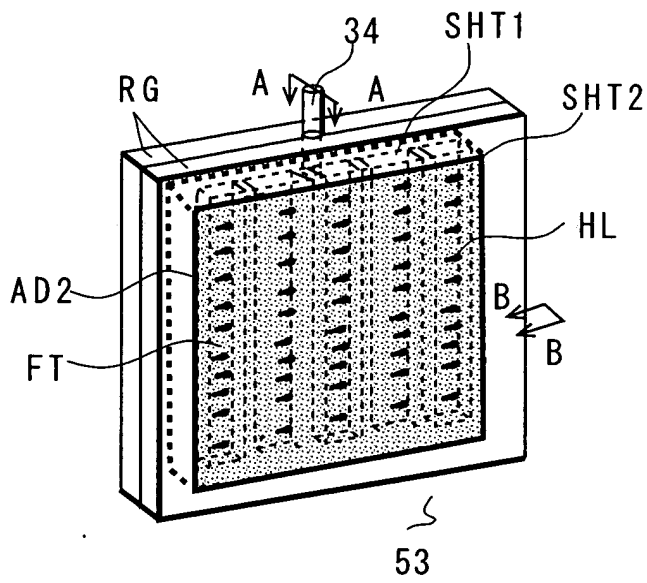


FIG.12D

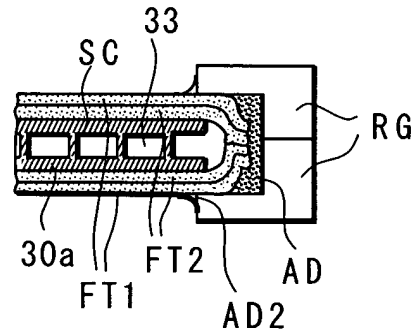


FIG.12C

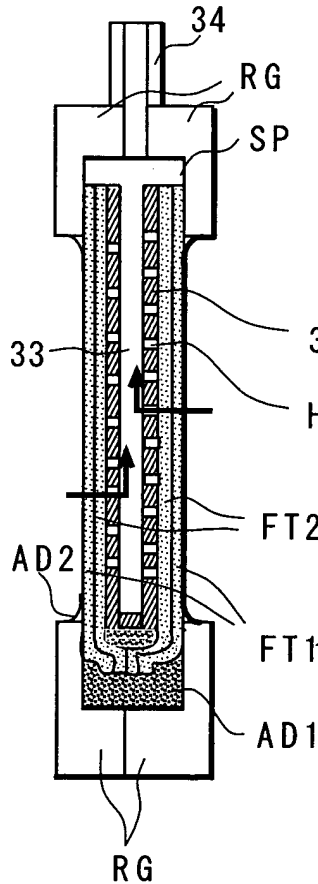


FIG.12B

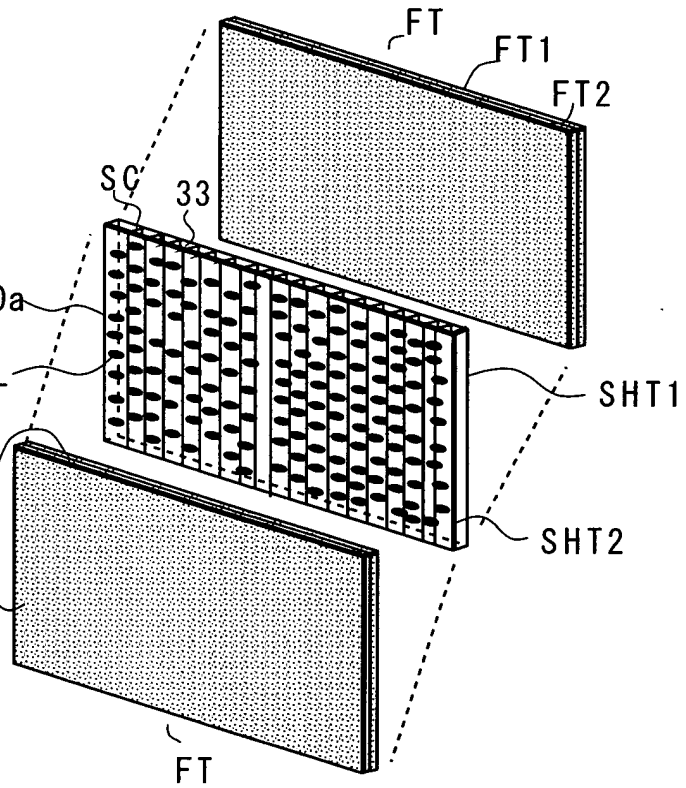


FIG.13A

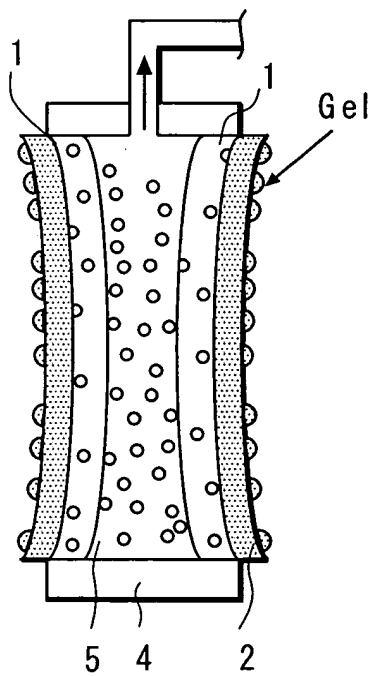


FIG.13B

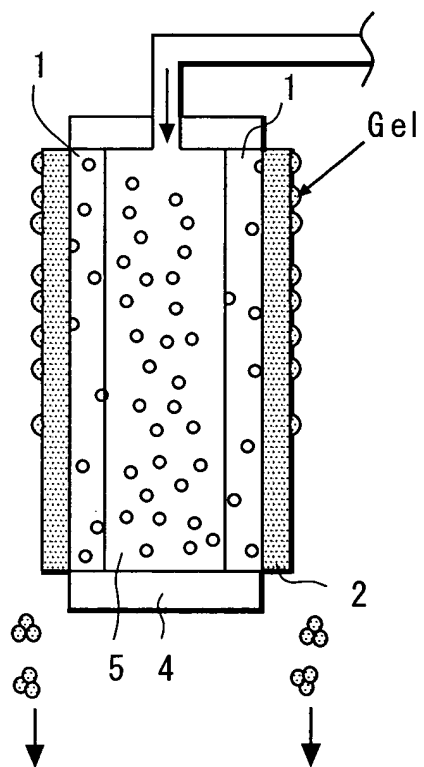


FIG.14

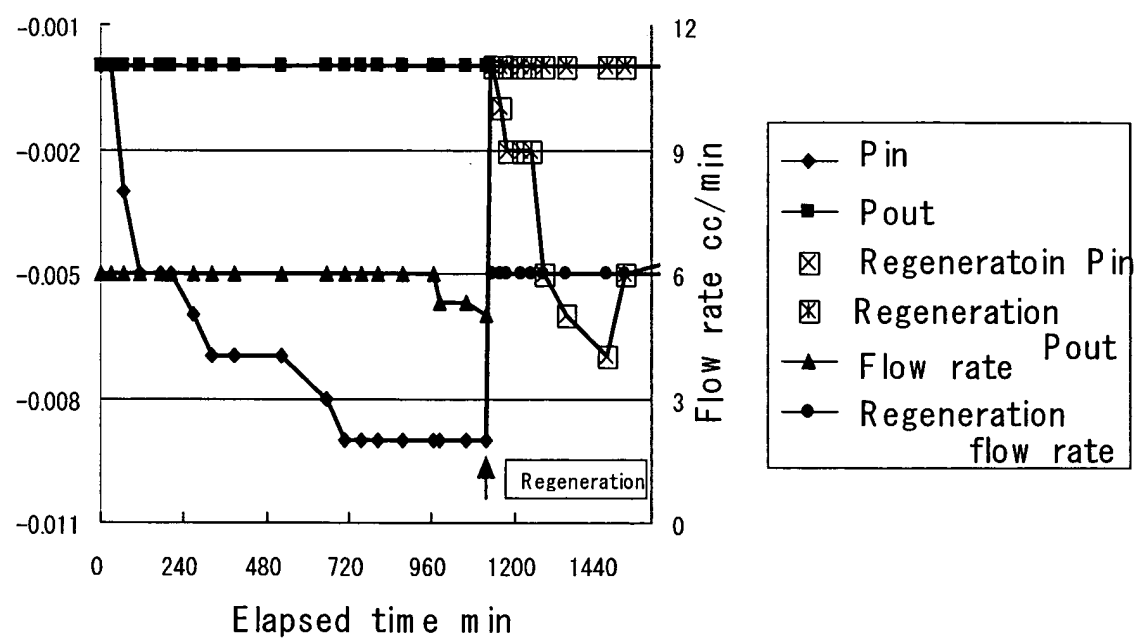


FIG.15A

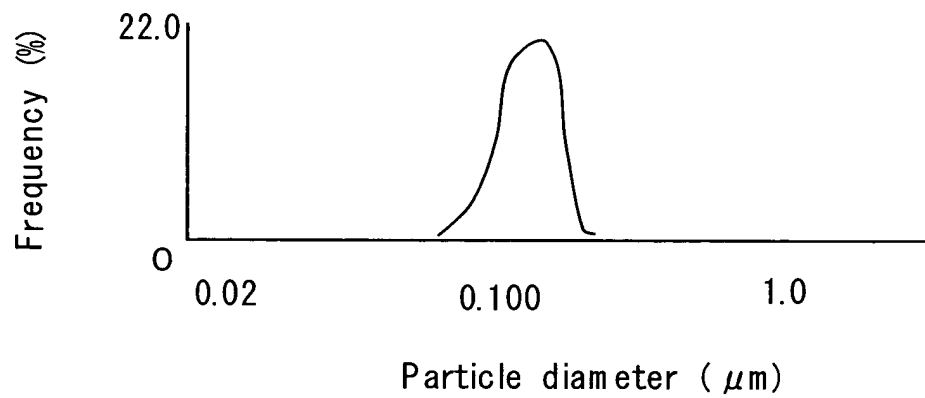


FIG.15B

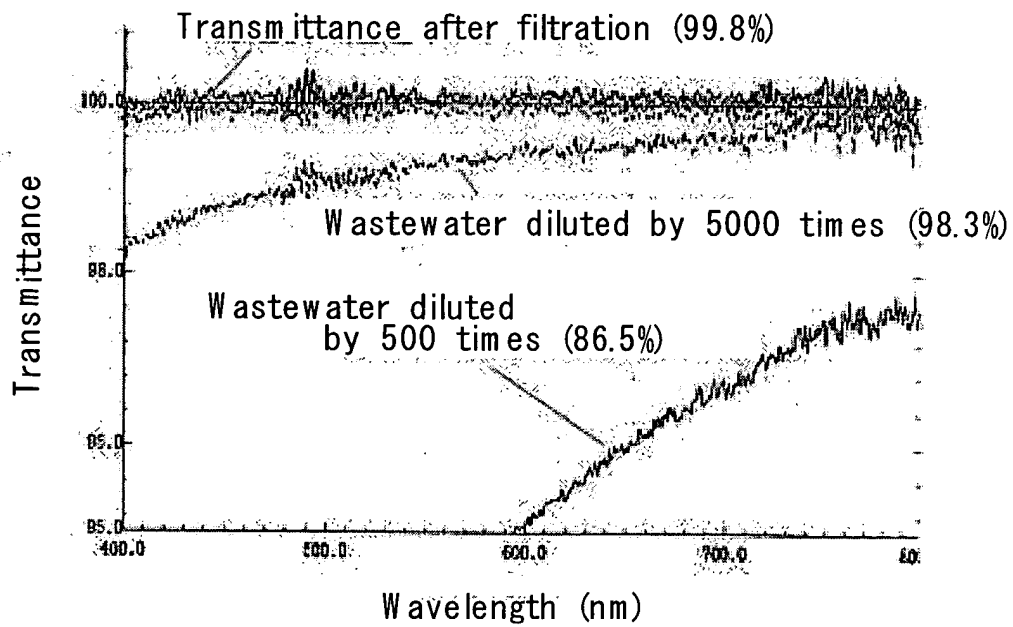


FIG. 16

15/17

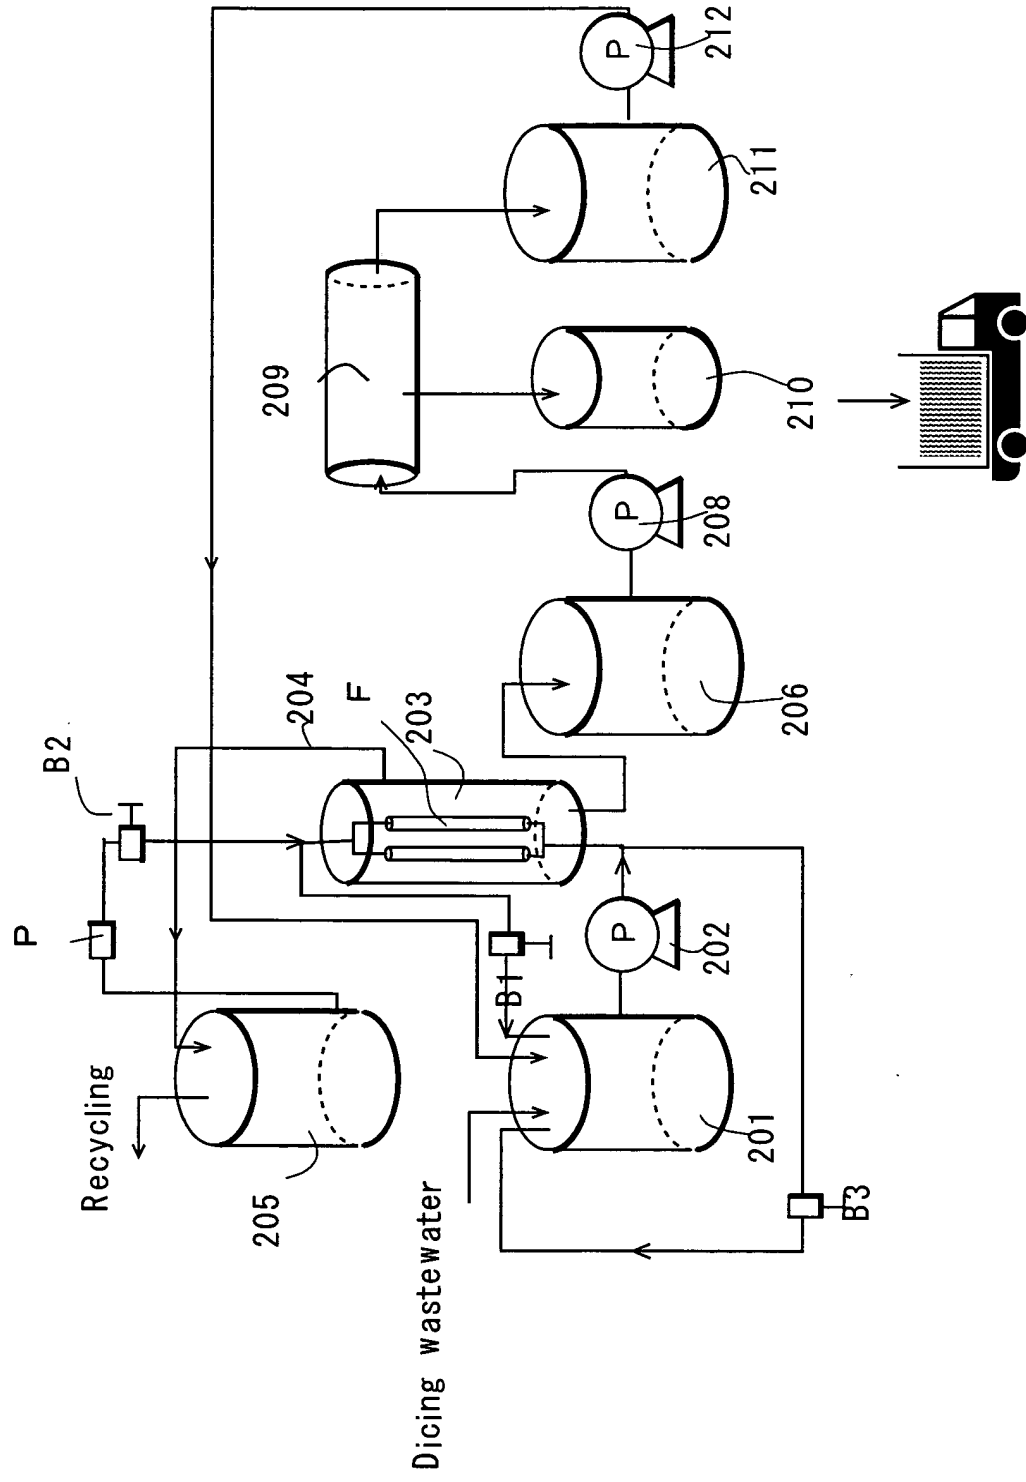


FIG. 17

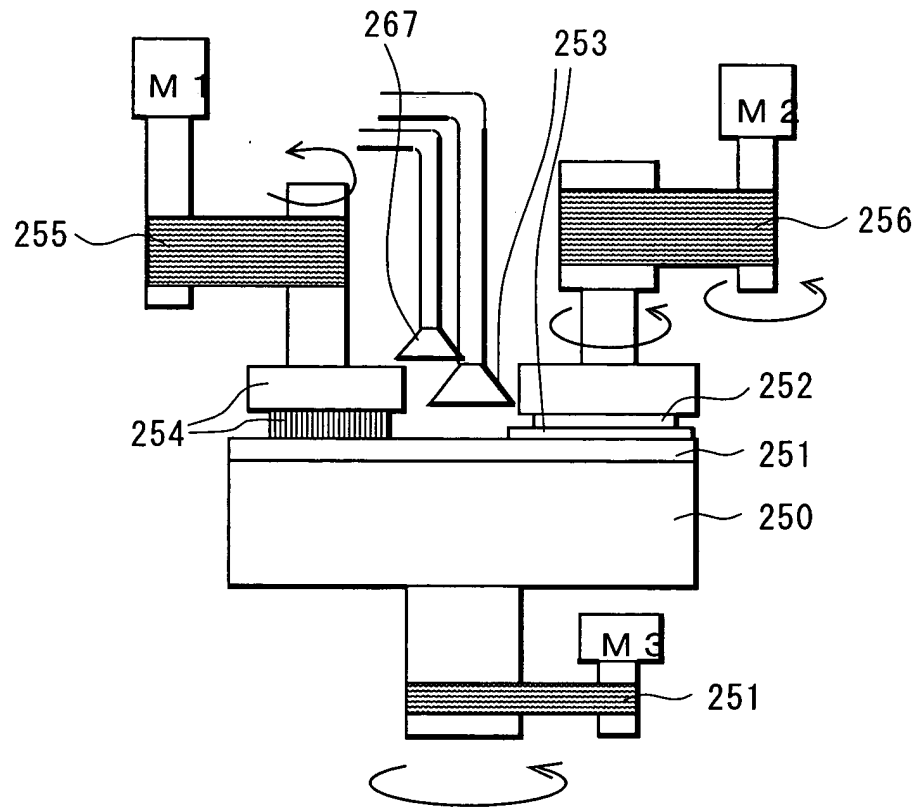




FIG.18

